

Sound reduction index in accordance with PN - EN ISO 10140-2 (2011)

Laboratory measurements of airborne sound insulation of building elements

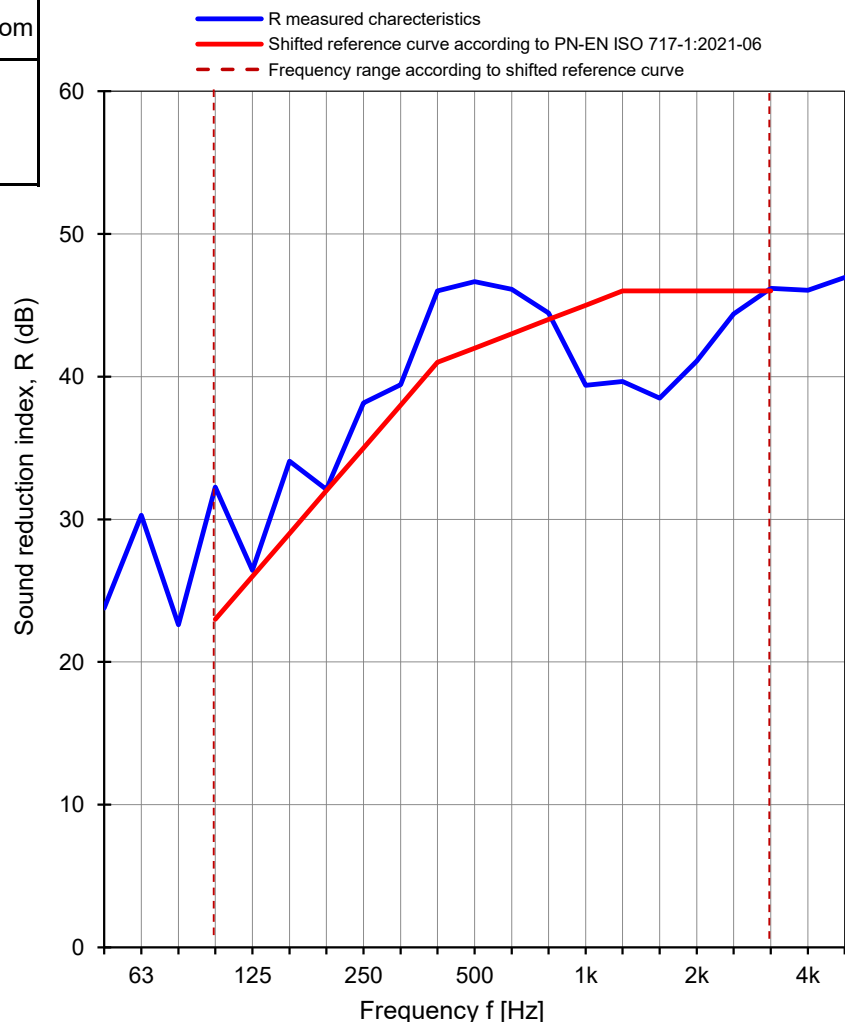
Client: **NorDan Sp. z o.o.**Measurement date: **05.11.2021**Address: **Powodowo 54, 64-200 Wolsztyn**Test specimen: **Wooden window****Pi LNR: 85****Construction: OD, ND NTech One Tilt and Turn****Frame thickness: 105 mm****Glazed by: 86.2 SR Foil / 24 Ar / 8**

Description of the test facility, test specimen and test arrangement:

Size of test specimen: **1230 x 1480 mm**Test specimen mounted by: **NorDan Sp. z o.o.**The surface area of test specimen: **1,87 m²**

Parameter	Receiving room	Source room
Air temp. [°C]	20,8	21,2
Humidity [%]	63	64
Pressure [hPa]	1008	1008
Volume [m ³]	372	324

Frequency [Hz]	Test results with uncertainty	
	R [dB]	U _{CR} [dB]
50	23,8	3,0
63	* 30,3	1,8
80	22,6	1,7
100	32,2	2,4
125	26,4	1,7
160	34,1	1,5
200	32,1	1,3
250	38,2	1,3
315	39,4	0,8
400	46,0	0,9
500	46,7	1,0
630	46,1	0,9
800	44,5	1,0
1000	39,4	0,8
1250	39,7	0,8
1600	38,5	0,7
2000	41,1	0,7
2500	44,4	0,7
3150	46,2	1,0
4000	46,0	1,0
5000	47,0	1,0

Measurement uncertainty of sound reduction U_{CR}

Confidence level 95% at coverage factor, k=2

* L_p-L_{pbackground} < 6 dB

Weighted sound reduction index in accordance with PN-EN ISO 717-1:2021-06

R_w (C; C_{tr}) = 42 (-1; -3) dBC₅₀₋₃₁₅₀ = -1 dBC₅₀₋₅₀₀₀ = -1 dBC₁₀₀₋₅₀₀₀ = -1 dBC_{tr, 50-3150} = -5 dBC_{tr, 50-5000} = -5 dBC_{tr, 100-5000} = -3 dB**R_w = 42,7 dB**

GRYFITLAB Sp. z o.o. Laboratory of Acoustics

No. of test specimen: GLA-1559.40 / 21

Date: 05.11.2021

Signature: Robert Dybicz